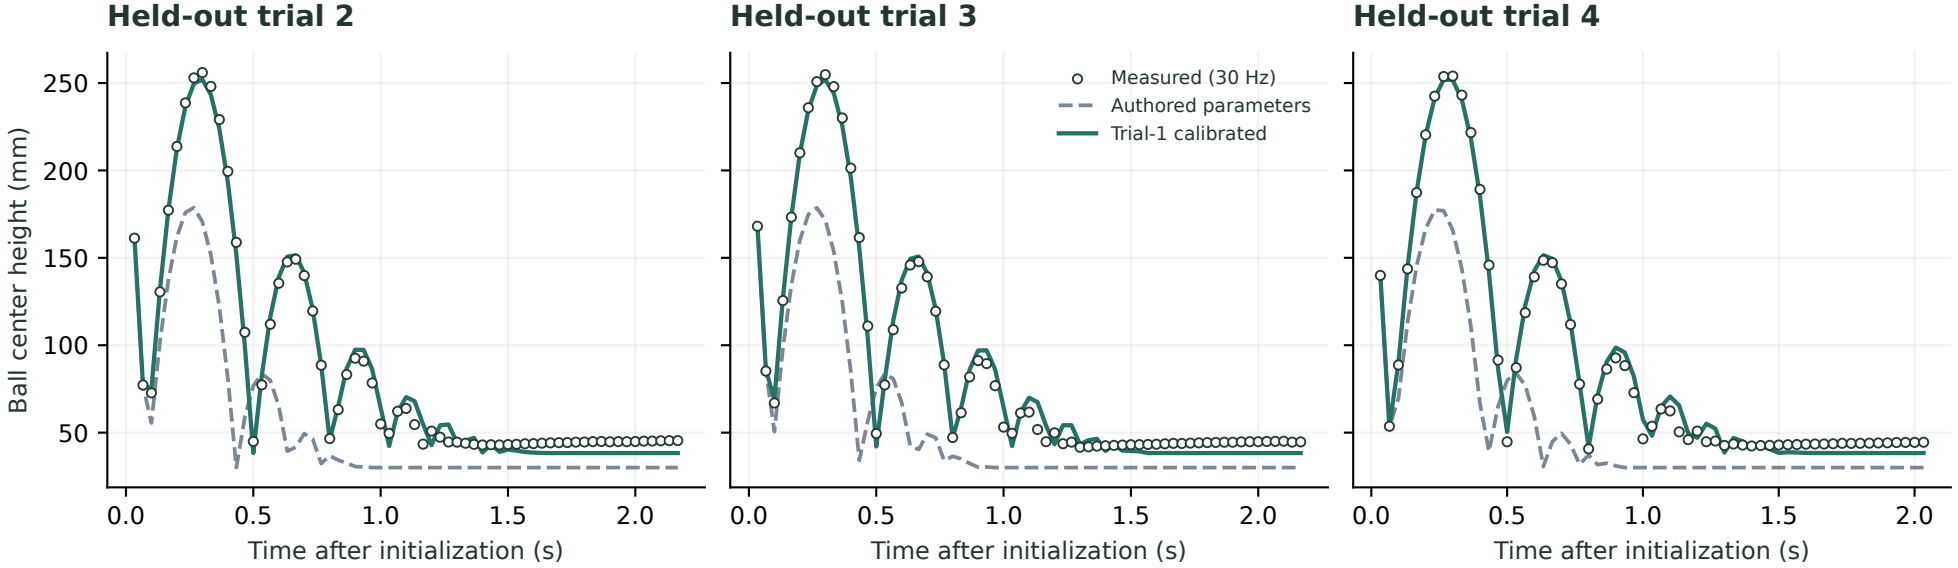
Held-out trial 2
Held-out trial 3
Held-out trial 4
Measured (30 Hz)
Authored parameters
Trial-1 calibrated
Ball center height (mm)
250
200
150
100
50
0.0
0.5
1.0
1.5
2.0
Time after initialization (s)